


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

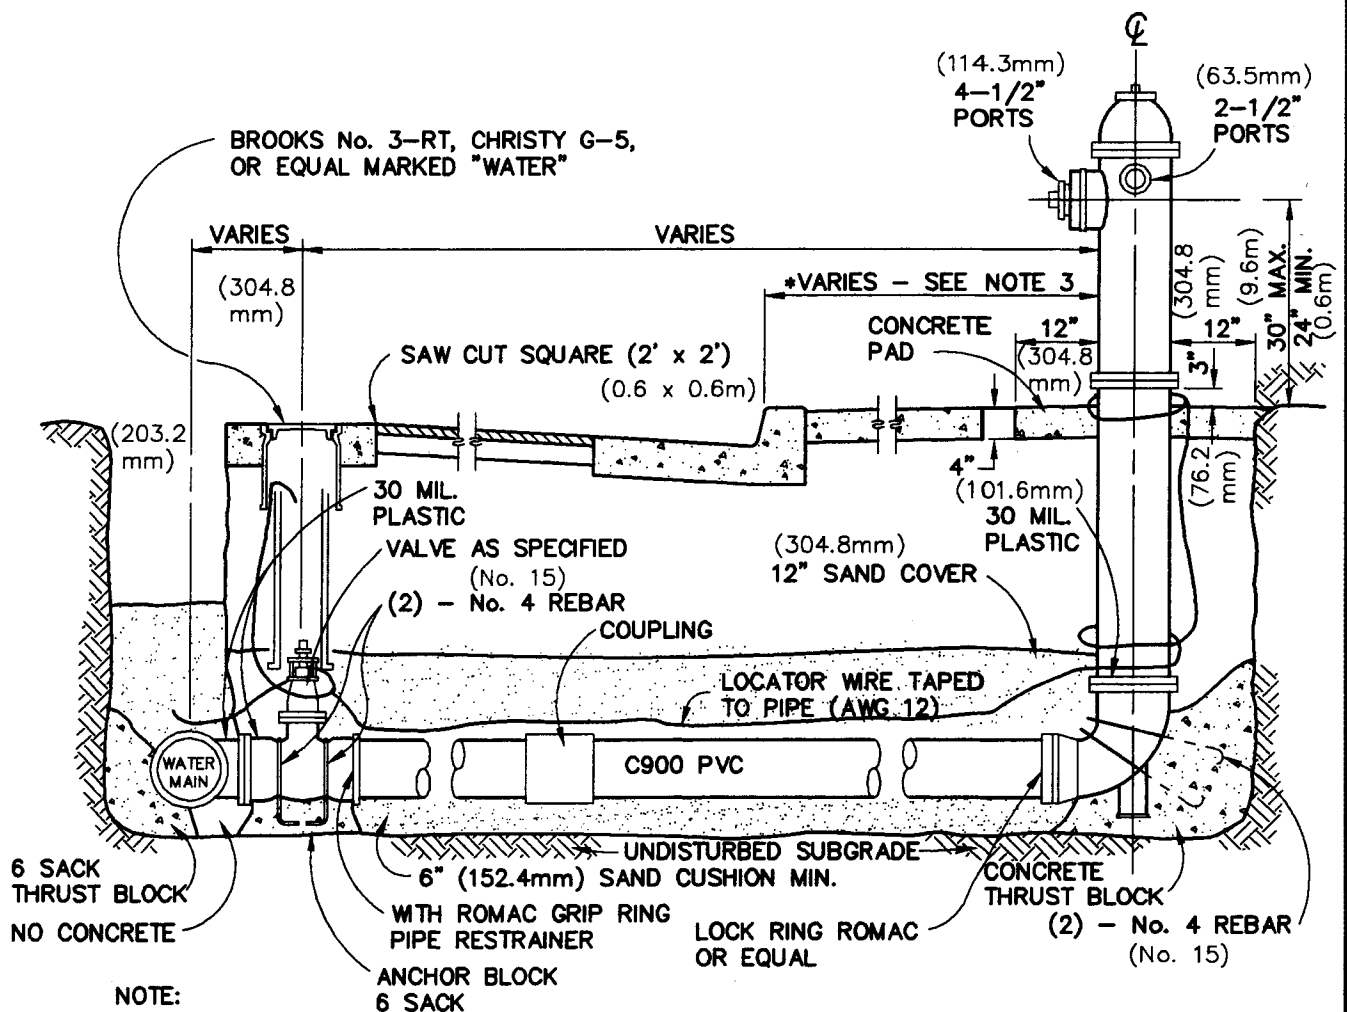

NOTE:

1. DEVELOPERS/INSTALLERS SHALL SUPPLY AND PLACE BLUE 2-WAY REFLECTORIZED RAISED ROADWAY MARKER(S) AS DIRECTED BY THE FIRE DEPT. AT EACH HYDRANT OR WARF HEAD (HAWKINS "RAY-O-LITE V16C-DB" OR APPROVED EQUAL).
2. ALL EXPOSED NUT AND BOLTS WHICH ARE BURIED SHALL BE COVERED WITH 30 MIL. PLASTIC.
- *3. SEE STANDARD DRAWING No. G-2 FOR LOCATION OF FIRE HYDRANT FROM CURB FACE.
4. SEE STD. DWG. G-3 FOR VALVE BOX DETAILS.

HYDRANT

3 WAY HYDRANT; MUELLER No. A-421, 1-1/2" (38.1mm) OPERATING NUT, 2-1/2" (63.5mm) NOZZLES, 4-1/2" PUMPER NOZZLE WITH MJ FITTING TO PIPE OR

WATEROUS PACER WB 67 x MJ 2-1/2" (63.5mm) NOZZLES, 4-1/2" PUMPER NOZZLE WITH MJ FITTING TO PIPE

VALVES

WATEROUS 500 RESILIENT WEDGE TYPE VALVE FLANGE BY MJ OR EQUAL

DRAWN BY: C.A.C.	CITY OF PASO ROBLES ENGINEERING DIVISION	DRAWING NO.
DESIGNED BY:		
DATE: 4/18/94	FIRE HYDRANT INSTALLATION	G-1
FILE NAME: PR-G-1.DWG		